



भारतीय मानक ब्यूरो
(उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय, भारत सरकार)
**BUREAU OF INDIAN
STANDARDS**

मानक भवन, 9, बहादुर शाह ज़फर मार्ग, नई दिल्ली – 110002
Manak Bhawan, 9, Bahadur Shah Zafar Marg, New Delhi –
110002
Phones: 23230131 / 2323375 / 23239402
Website: www.bis.org.in , www.bis.gov.in

प्रारंभिक मसौदा

हमारा संदर्भ : सीईडी 38/टी-3

11 नवंबर 2024

तकनीकी समिति : विशेष संरचना विषय समिति, सीईडी 38

प्राप्तकर्ता :

- सिविल इंजीनियरी विभाग परिषद्, सीईडीसी के सभी सदस्य
- सीईडी 38 के सभी सदस्य
- रूचि रखने वाले अन्य निकाय

प्रिय महोदय/महोदया,

निम्नलिखित भारतीय मानक का मसौदा संलग्न है:

प्रलेख संख्या	शीर्षक
सीईडी 38 (26910)P	प्रारंभिक मसौदा प्रबलित कंक्रीट मेहराब के डिज़ाइन के लिए मानदंड का प्रारंभिक मसौदा (IS 4090 का पहला पुनरीक्षण) ICS NO. 91.080.40

कृपया इस मसौदे की जाँच करें और इसमें और सुधार के संबंध में अपनी सम्मतियाँ साझा करें।

सम्मतियाँ भेजने की अंतिम तिथि: 02/12/2024

सम्मति यदि कोई हो तो कृपया अधोहस्ताक्षरी को ई-मेल द्वारा ced38@bis.gov.in पर या उपरलिखित पते पर, संलग्न फॉर्मेट में भेजें।

आपको अपनी टिप्पणियाँ सबमिट करने के लिए लॉग इन करने की आवश्यकता हो सकती है, कृपया लॉग इन करने के लिए अपने मोबाइल नंबर (बीआईएस को प्रदान किया गया) और ओटीपी प्रावधान का उपयोग करें।

यदि कोई सम्मति प्राप्त नहीं होती है अथवा सम्मति में केवल भाषा संबंधी त्रुटि हुई तो हम मान लेंगे कि प्रारंभिक मसौदे के लिए आपका अनुमोदन प्राप्त हुआ है। यदि सम्मति तकनीकी प्रकृति की हुई तो उसे विषय समिति के अध्यक्ष के परामर्श से आवश्यक कार्रवाई के लिए विषय समिति के सामने रखा जाएगा।
धन्यवाद।

भवदीय
(अशोक सारण)
सदस्य सचिव सीईडी 38
वैज्ञानिक 'बी' (सिविल इंजीनियरिंग)
ई-मेल: ashoksaran@bis.gov.in

संलग्न: उपरलिखित

**भारतीय मानक ब्यूरो**

(उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय, भारत सरकार)

**BUREAU OF INDIAN
STANDARDS**मानक भवन, 9, बहादुर शाह ज़फ़र मार्ग, नई दिल्ली – 110002
Manak Bhawan, 9, Bahadur Shah Zafar Marg, New Delhi –
110002

Phones: 23230131 / 2323375 / 23239402

Website: www.bis.org.in, www.bis.gov.in**PRELIMINARY DRAFT****Our Reference: CED 38/T- 3****11 November 2024****Technical Committee: Special Structures Sectional Committee, CED 38****Addressed To:**

- All Members of Civil Engineering Division Council, CEDC
- All Members of CED 38
- All others interested

Dear Sir/Madam,

Please find enclosed the following document:

<i>Doc No.</i>	<i>Title</i>
CED 38 (26910)P	Preliminary Draft for Criteria for the design of reinforced concrete arches [First Revision of IS 4090] ICS NO. 91.080.40

Kindly examine the attached draft and forward your comments for further improvement.

Last Date for comments: 02 December 2024Comments, if any, may please be made in the format as enclosed herewith and e-mailed to the undersigned at ced38@bis.gov.in.

In case no comments are received, or comments received are of editorial nature, kindly permit us to presume your approval for the above document. However, in case comments of technical nature are received, then in consultation with the Chairperson, CED 38 the comments may be put up to the Sectional Committee for necessary action.

Thanking you,

Sd/-

(Ashok Saran)

Member Secretary CED 38

Scientist 'B' (Civil Engineering)

E-mail: ashoksaran@bis.gov.in**Encl: As above**

FORMAT FOR SENDING COMMENTS ON THE DOCUMENT

(Please use A4 size sheet of paper only and type within fields indicated. Comments on each clause/sub-clause/ table/figure, etc, be stated on a fresh row. Information/comments should include reasons for comments, technical references and suggestions for modified wordings of the clause.) Please e-mail your comments to ced38@bis.gov.in.

Doc. No.: CED 38(26910)P

BIS Letter Ref: CED 38/T-3

Title: Criteria for the design of reinforced concrete arches
[First Revision of IS 4090]

Last date of comments: **02 December 2024**

Name of the Commentator/ Organization: _____

SI No.	Clause/ Para/ Table/ Figure No. commented	Comments/ Modified Wordings	Justification of Proposed Change
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
13.			

NOTE- Kindly insert more rows as necessary for each clause/table, etc

BUREAU OF INDIAN STANDARDS

Preliminary Draft Indian Standard

CRITERIA FOR THE DESIGN OF REINFORCED CONCRETE ARCHES

ICS 91.080.40

FOREWORD

(Formal clauses will be added later)

Reinforced concrete arches, because of their aesthetic appearance and ability to carry heavy loads over large spans, are advantageously used in bridges, monumental buildings, assembly or exhibition halls and similar other structures. The use of reinforced concrete allows much greater freedom in the choice of arch curve and very large spans are possible even with heavy loads without the necessity of fitting the arch curve to the pressure curve. However, the design of an economical arch has always been a rather lengthy process involving several sets of calculations and in this standard an attempt has been made to give general recommendations for guidance in the design of reinforced concrete arches. Certain essential features of construction which have a bearing on the design have also been briefly covered.

The provisions laid down in the standard are for the general guidance for designers and are applicable to reinforced concrete arches of spans up to 120 m and with rise to span ratio between $1/8$ and $1/3$. The designers may adopt other suitable methods of design and construction provided there is sufficient evidence by analysis or tests or both to prove the adequacy and safety of the method adopted. It has also been assumed that the design of reinforced concrete arches is entrusted to a qualified engineer and the execution of the work is carried under the directions of an experienced supervisor.

This criteria is complementary to IS 456:2000 and the recommendations for usual reinforced concrete construction apply to reinforced concrete arches also.

Various formulae in 8 and 9 are a few of the formulae commonly adopted for the purpose and have been given in this standard as an aid for ready reference but the designer is free to use any other suitable formulae.

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS 2:2022. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

Major and significant Revisions in the present standard are,

- a) As the Code of practice for plain and reinforced concrete is revised considering state of the art of technology, provisions of this code are adopted wherever applicable. Wherever, clarification is needed, IS 456 may be referred to.
- b) Considering the developments in the reinforcing steel manufacturing industry high strength steels are adopted for use.
- c) Importance of durability and health of structures is identified as a primary factor for designing structure to last longer, provisions of IS 456 are referred, as applicable.

*Preliminary Draft Indian Standard***CRITERIA FOR THE DESIGN OF REINFORCED CONCRETE ARCHES****1 SCOPE**

This standard lays down recommendations for the classification, dimensional proportioning, analysis and design of reinforced concrete arches. The criteria for design is intended to apply only to arches which are primarily loaded (with dead and live loads) in their own plane and where curve lies in one plane. Portals are not covered by this criteria.

2 REFERENCE

The standards listed below contain provisions which through reference in this text, constitute provision of this standard. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this standard are encouraged to investigate the possibility of applying the most recent edition of these standards.

<i>IS No.</i>	<i>Title</i>
IS 456 : 2000	Plain and reinforced concrete — Code of practice (<i>fourth revision</i>)
IS 875 (Part 3) : 2015	Design Loads (Other than Earthquake) for Buildings and Structures — Code of Practice Part 3 Winds Loads (<i>third revision</i>)
IS 1893 : 1984	Criteria for earthquake resistant design of structures (<i>fourth revision</i>)
IS 432 (Part 1) : 1982	Specification for mild steel and medium tensile steel bars and hard-drawn steel wire for concrete reinforcement: Part 1 Mild steel and medium tensile steel bars (<i>third revision</i>)

3 TERMINOLOGY

3.1 For the purpose of this standard, the following definitions shall apply (see Fig.1).

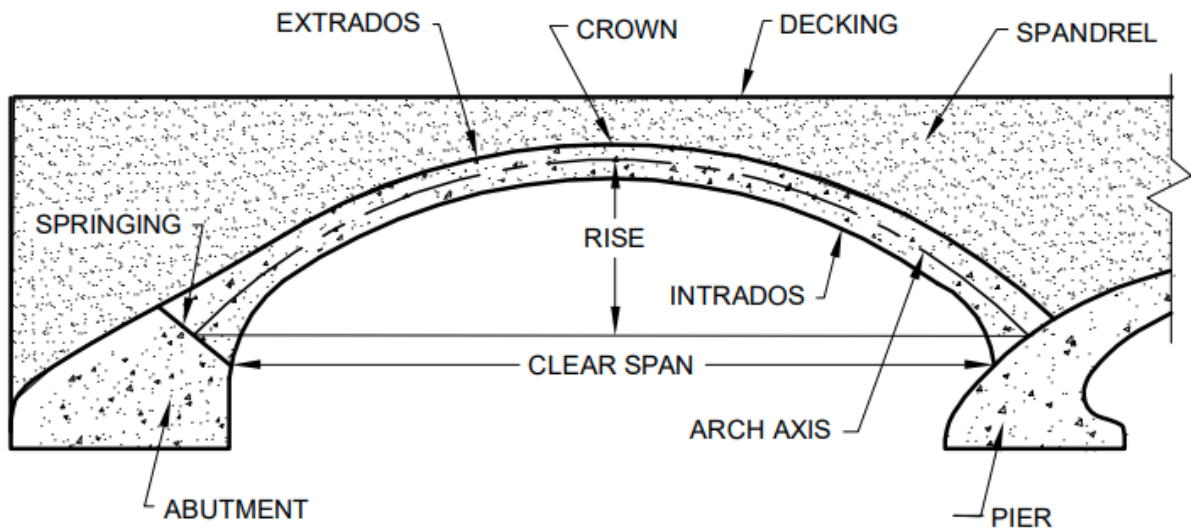


FIG. 1 TERMINOLOGY RELATING TO AN ARCH

3.2 Arch – Beam curved in one plane which is also the plane of loading with respect to dead load and live loads, and in which the displacement of the ends are restricted.

3.3 Back – The top surface of the arch.

3.4 Clear Span – The horizontal distance between the springing lines on a plane parallel to the axis of the arch.

3.5 Crown – The highest point on the arch axis.

3.6 Extrados – The line of intersection of the back of the arch with the plane parallel to the axis of the arch.

3.7 Hinge – Unless otherwise defined, a hinge is an artifice which is so designed and constructed as to provide no resistance to rotation (flexural resistance) so that the bending moment at the section of hinge can be assumed in the analysis to be zero. Hinges may be temporary or permanent.

3.8 Intrados – The line of intersection of the soffit with the plane parallel to the axis of the arch.

3.9 Right Arch - An arch in which the angle made by the springing line with the plane of axis of the arch is 90° .

3.10 Rise – The height of the arch axis at the crown above the level of the springing point. Unsymmetrical arches have different rises with respect to each springing point.

3.11 Skew Arch – An arch in which the angle made by the springing line with the plane of axis of the arch is not 90°.

3.12 Skew Back – The area of the support from which the arch springs.

3.13 Soffit – The under surface of the arch.

3.14 Spandrel – The space between the back of the arch and the decking.

3.15 Springing Line – The line of intersection of the face of the support and the soffit. Unsymmetrical arches have their two springing lines at different levels.

3.16 Springing Point – The point of intersection of arch axis with the face of the support.

3.17 Symmetrical Arch – An arch symmetrical about the crown and having its end supports at the same level.

3.18 Unsymmetrical Arch – An arch which is not symmetrical about the crown and which has its end supports at different levels.

4 NOTATIONS

4.1 For the purpose of this criteria and unless otherwise defined in the text, the following letter symbols shall have the meaning indicated against each:

A_{sc}	Cross sectional area of steel in compression
a	Depth of the stress block for compression in concrete
b	Width of the arch rib or the unit width of the arch slab
d	Depth from the compression face to the tension steel of the arch rib
d_o	Distance between the compression and tension steels in the section
e	Eccentricity of load P on the arch section
E_c	Modulus of elasticity of concrete
E_s	Modulus elasticity of steel
σ_{sv}	Yield strength of steel reinforcement
h	Rise of arch
H	Horizontal dead load thrust in the arch at the crown
I	Moment of inertia of the arch rib at any section
I_c	Moment of inertia of the arch rib at the crown
I_s	Moment of inertia of the arch rib at the springing
L	Span of the arch
U	Ultimate strength of the arch section under direct and bending stresses
t	Thickness or depth of the arch rib
W_s	Average load on arch per unit length of span near springing
W_c	Average load on arch per unit length of span near crown
θ	Angle which the tangent to arch axis makes with the horizontal at the section under consideration

θ_s Slope of the arch at the springing, that is, the angle which the tangent to the arch axis makes with the horizontal at the springing

5 TYPES OF ARCHES

5.1 Structurally arches may be classified into the following (see Fig. 2):

- a) Fixed or hingeless arches, and
- b) Hinged arches.

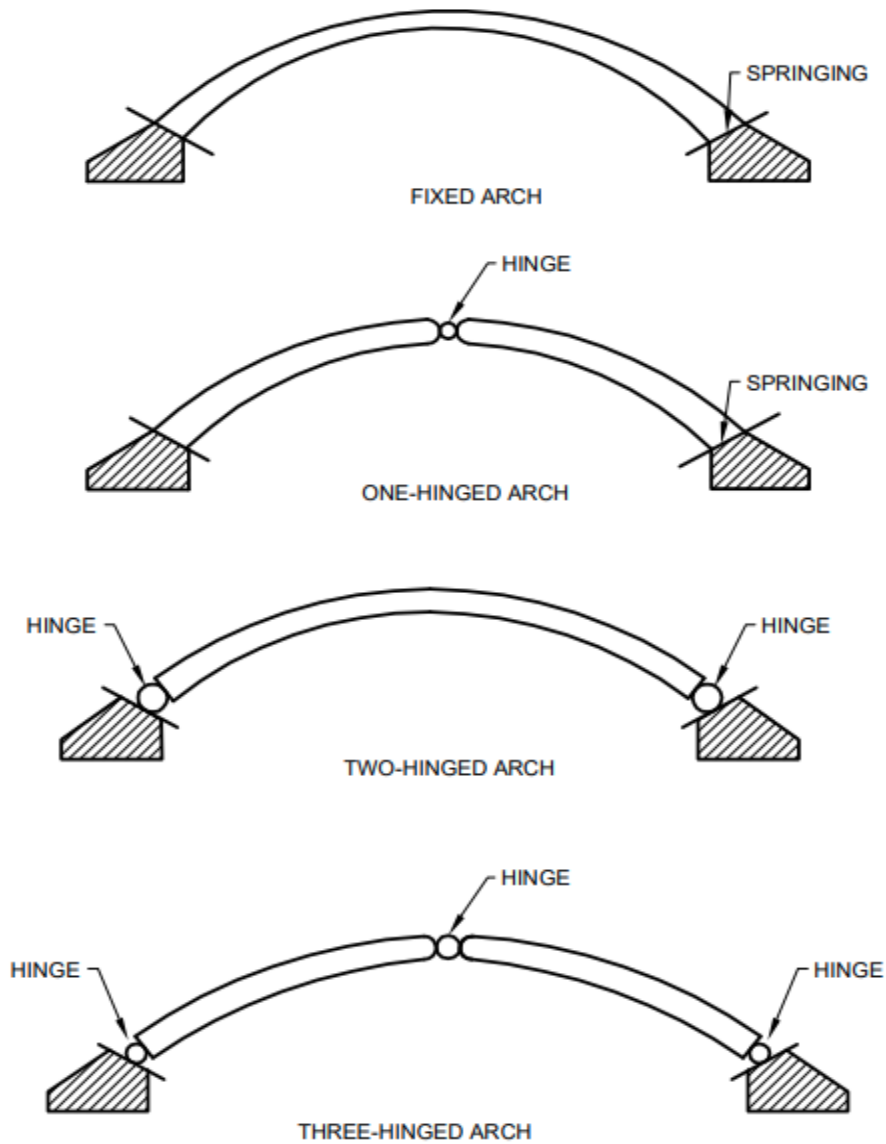


FIG. 2 STRUCTURAL CLASSIFICATION OF CONCRETE ARCH

5.1.1 Fixed or Hingeless Arches

These have their ends built rigidly into the supports which do not allow them to move or rotate. Concrete arches are usually of this type.

5.1.2 Hinged Arches

These arches may have only one hinge at the crown, or two hinges; one at each springing, or three hinges; one at each springing and one at the crown. Hinged arches are not commonly employed in concrete. Temporary hinges are, sometimes, introduced during construction.

5.2 Based on construction, an arch can be identified as:

- a) filled spandrel arch,
- b) open spandrel arch, and
- c) tied arch or bow-string girder

5.2.1 Filled Spandrel Arch

This arch consists of an arch slab carrying a filling of earth or any other suitable material on its back in the spandrel portion (see Fig. 1).

5.2.2 Open Spandrel Arch

It consists of an arch slab carrying a system of walls, piers or columns on its back to support the decking; or arch ribs supporting the decking at any level above the crown or between the crown and springings, through a system of columns or suspenders or both (see Fig. 3).

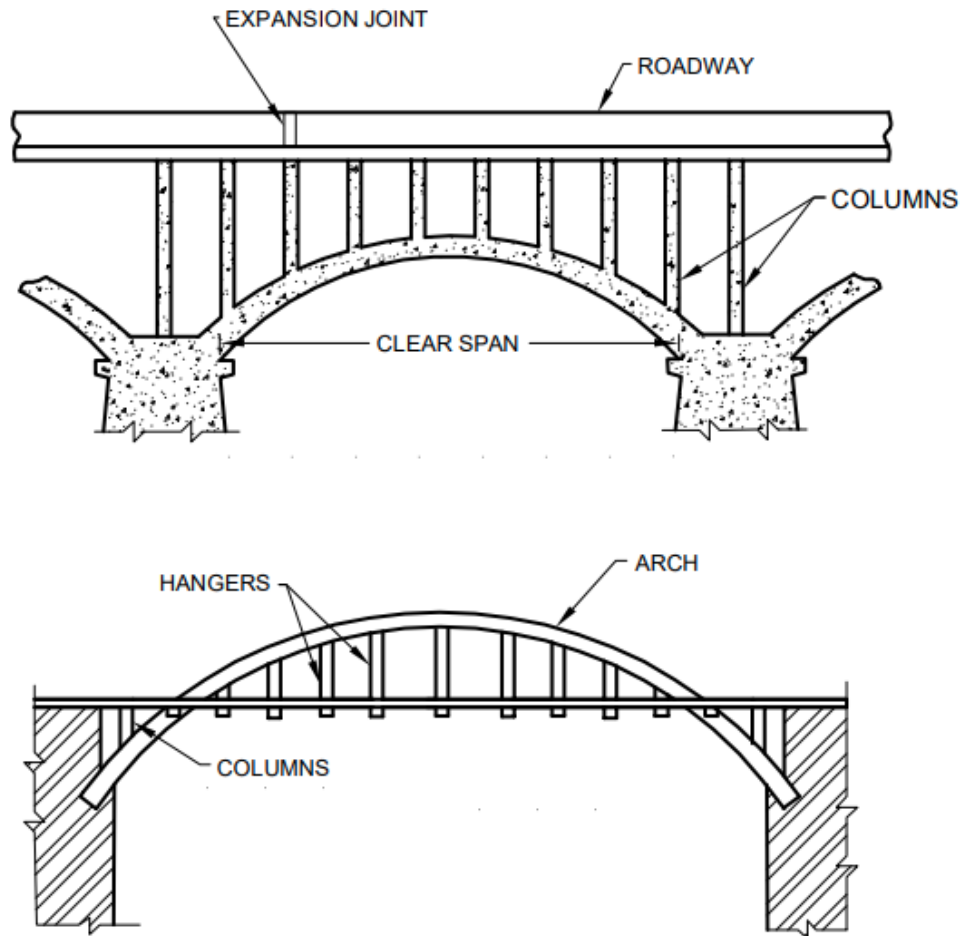


FIG. 3 CLASSIFICATION OF CONCRETE ARCHES BASED ON CONSTRUCTION – TYPICAL OPEN SPANDREL ARCH

Spandrel Walls (From AASHTO)

When the spandrel walls or filled spandrel arches exceed 2.5m (8 feet) in height above the extrados, they shall be designed as vertical slabs supported by transverse diaphragm walls or deep counterforts. Vertical cantilever walls over 2.5m (8 feet) in height, or counterforts having a back slope of less than 45 degrees with the vertical, shall not be used, on account of the excessive and indeterminate stresses set up in the arch by torsion.

Drainage of Spandrel Fill

The fills of filled spandrel arches shall be effectively drained by a system of tile drains or French drains laid along the intersection of the spandrel walls and arch and discharging through suitable outlets in the piers and abutments. The location and details of the

drainage outlets shall be such as to eliminate, as far as possible, the discoloration by drainage water of the exposed masonry faces.

5.2.3 Tied Arch or Bow-String Girder

Where supports cannot resist the horizontal reaction effectively, a tie at the level of springing is used to take up the horizontal thrust and such an arch is called a tied arch (see Fig. 4).

NOTE — A bow-string girder is a form of tied arch. It consists of arch ribs with horizontal ties, and suspenders supporting the ties.

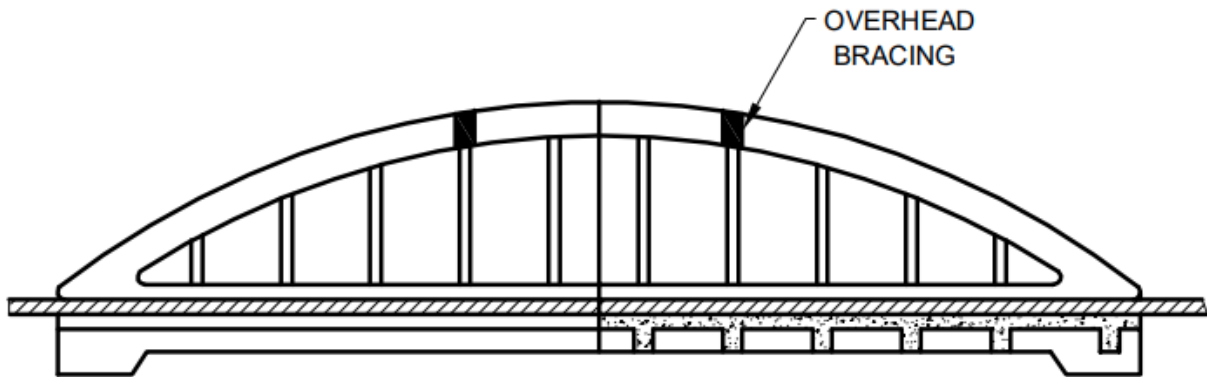


Fig. 4 CLASSIFICATION OF CONCRETE ARCHES BASED ON CONSTRUCTION
TYPICAL-TIED ARCH OR BOW-STRINGS GIRDER

Shape of Arch (From AASHTO, added in present revision)

Arch shall be selected as to shape in such manner that the axis of the arch shall conform, as nearly as practicable, to either the equilibrium polygon for full dead load or to the equilibrium polygon for full dead plus one-half live load over the full span, whichever produces the smallest bending stresses under combined loads.

6 LOADS

6.1 For the purpose of design of reinforced concrete arches, the following loads shall be considered:

- a) Dead load;
- b) Live load;
- c) Wind load;
- d) Seismic load;
- e) Tractive force; and
- f) Snow load, where applicable.

The effect of temperature variations and shrinkage shall also be taken into account.

6.2 Dead Loads

6.2.1 Filled Spandrel Arches

In these arches, the load carried by the arch includes the self-weight, the weight of fill and the roadway, if any. If the fill consists of loose material like earth, it exerts pressure on the arch which has horizontal besides vertical components.

6.2.1.1 When the ratio of depth of fill above the crown to the span of the arch exceeds one, the fill is treated as a deep fill.

6.2.1.2 When the depth of fill is less than indicated above, full weight of fill will be borne by the arch.

6.2.2 Open Spandrel Arches and Tied Arches

In these arches, the arch segment supports the self weight, the reaction transmitted by the decking, and the weight of the spandrel supports. While calculating the dead load reactions on these supports, the effect of continuity of the decking, may be taken into account and the spandrel supports may be treated as hinged at both ends.

6.3 Live Loads

6.3.1 The live loads for design should correspond to the relevant standard code of practices for buildings or bridges as the case may be.

6.3.2 Filled Spandrel Arches

In these arches, if the live load is uniformly distributed, it can be treated as such for analysis. If it is a wheel load covering a small area, it is taken to disperse at an average angle of 45° with the vertical through the fill and the arch slab, and the dispersion area at the level of the arch-axis gives the effective area of the arch bearing the load. When the dispersed loaded area due to two or more adjoining loads overlaps, as shown in Fig. 5, the loads are treated jointly and their total load taken as dispersed over the area **A B' C' D**.

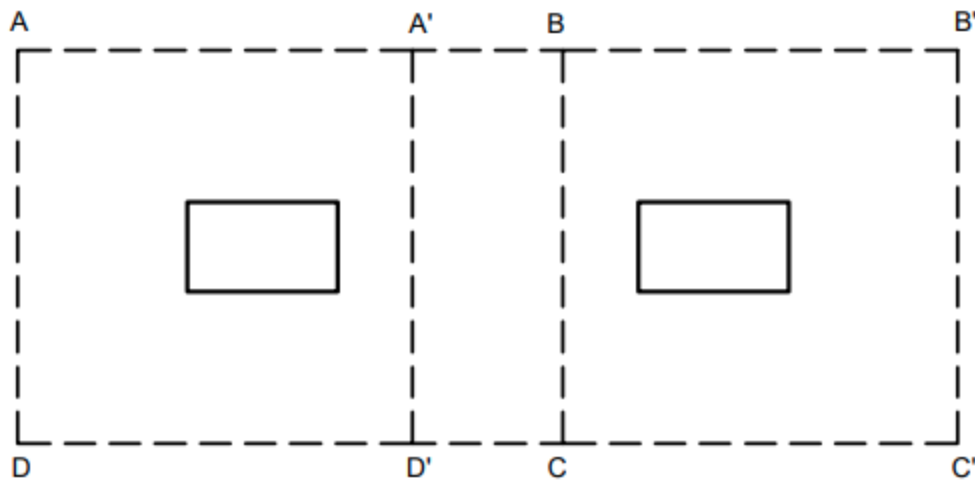


FIG. 5 LOAD DISPERSION DIAGRAM DUE TO TWO ADJOINING LOADS

6.3.3 Open Spandrel Arches and Tied Arches

In these arches, the live load acts on the arch as a series of loads transmitted by the decking supports, assuming that the supports are hinged to the arch. In calculating the effect of wheel loads, the longitudinal dispersion of the load need not be considered as the effect of such dispersion is negligible.

NOTE — The decking supports are assumed to be hinged to the arch. In actual practice, the bars are not crossed to form a hinge, but are anchored straight. However, being of smaller section compared to the arch, the supports can be assumed to be hinged to the arch.

6.4 Wind Force

The wind force can be estimated to the requirements of IS 875 (Part 3). It is supposed to act transversely to the structure and the live load.

6.4.1 In the filled spandrel arches, the arch slab is analysed as a curved beam to take up the transverse wind forces.

6.4.2 The open spandrel arch is analysed in the same way as for transverse seismic force (see also **6.5.3**).

6.5 Seismic Force

6.5.1 Seismic force can be estimated to the requirements of IS 1893. It can act either parallel to the arch longitudinally or transverse to it. It is taken acting at the centre of gravity of each mass and live load on the structure.

6.5.2 Filled Spandrel Arches

The seismic forces may be ignored in the filled spandrel arches. However, these shall be considered in the design of the sub-structure, including piers, abutments and foundations.

6.5.3 Open Spandrel Arches

6.5.3.1 Under longitudinal seismic force

The forces due to seismic action on the decking is transmitted to the arch in the same way as tractive force. The force on arch and spandrel supports acts at the centre of gravity of the respective segments of the arch.

6.5.3.2 Under transverse seismic force

The forces due to seismic action on the decking causes increased load on one portion of the arch slab (or one of arch rib) and a corresponding decrease in load on the other portion of the arch slab (or the other arch rib). Arch should be checked, for these increased loads. The decking is supported on masonry abutments or reinforced concrete portals at the ends, strong enough to receive transverse forces transmitted by the decking acting as a horizontal girder.

If the arch consists of arch slab, the transverse force on the arch and spandrel supports is taken by the arch slab acting as a curved beam, and the force on the live load and decking by the decking acting as a horizontal girder.

If the arch consists of an arch slab the transverse force on the arch and spandrel supports shall be assumed to be resisted by the arch slab acting as a curved beam and the force on the live load and decking by the decking acting as a horizontal girder.

If the arch consists of arch ribs, the transverse force on the ribs and spandrel supports shall be assumed to be transmitted to the decking and the decking assumed to carry the entire transverse force to the end abutments or portals as a horizontal girder.

When joints are provided in the decking, the transverse force on the portion of the decking in between the joints, shall be assumed to be transmitted to the arch ribs. Alternatively, the arch ribs should be braced suitably to bear the resulting bending moments and torsion. Vertical acceleration need not be considered.

6.5.4 Bow String Girders

6.5.4.1 Under longitudinal seismic force

The force on live load and decking is carried directly to the supports. The force on suspenders may be assumed to be transferred half on the arch and half on the decking.

The force on the arch rib itself shall be assumed to act at the centre of gravity of its various segments.

6.5.4.2 *Under transverse seismic force*

The transverse force on the live loads causes increased loads on the leeward arch rib, and it should be checked for these. The force on the arch ribs and suspenders is transmitted by the suspenders acting as cantilevers fixed to the decking. The decking carries the entire transverse force to the supports as a horizontal girder. Where possible as an alternative arrangement, the two ribs may be suitably braced to bear the resulting moments and torsion.

6.6 Tractive Force

6.6.1 Tractive forces should be considered in case of bridges and can be estimated by referring to relevant codes.

6.6.2 *Filled Spandrel Arches*

In these arches, the tractive force can be ignored.

6.6.3 *Open Spandrel Arches*

If the decking is provided at the level of the crown, the tractive force shall be assumed to act at the crown only, as spandrel supports are comparatively too flexible to transmit this force at other points of the arch. But if the decking is supported at any other level by means of columns and suspenders, this force shall be distributed at the panel points along the arch in the ratio of the stiffnesses of spandrel supports. If the decking is supported by the abutments at the ends, all the tractive force shall be assumed to have been directly transmitted to the abutments. If horizontal bracings are used to connect the spandrel supports, these shall transmit their share of the longitudinal force to the arch through the top-most horizontal brace connecting spandrel supports with the arch.

6.6.4 *Bow-String Girders*

In these, the tractive force is transmitted by the decking directly to the supports.

6.7 Temperature

Variation of temperature occurs due to heat of hydration during setting of cement as well as due to fluctuation of air temperature.

6.7.1 *Heat of Hydration*

The stresses due to this cause can be eliminated if the key section of the arch is poured after most of the heat of hydration has been dissipated. The period required to dissipate

a major portion of this heat depends on the conditions and the sequence of pouring the arch. Normally, this period is 8 to 15 days.

6.7.2 Variation of Air Temperature

Temperature variation will have no appreciable effect on tied arches, which are free to move at the ends. Relevant recommendations of IS 456 may be followed.

6.8 Shrinkage

Shrinkage produces direct as well indirect effects. Direct effect is of a local nature and results in merely a redistribution of stresses on the section. This redistribution of stresses does not affect the ultimate strength of the section and hence, may be neglected.

6.8.1 The indirect effect is caused by a decrease in the length of axis and the stresses caused are of the same nature as due to a fall of temperature. The shrinkage coefficient of concrete in arches is of the order of 0.000 15. However, about 60 percent of its effect on stresses is relieved by creep of concrete. It is recommended to take shrinkage as equivalent to a fall of temperature of 15°C, for purposes of calculating stresses. For calculating deflections, shrinkage strain may be taken equal to 0.000 15. Shrinkage may be considered in design only if it produces worse effects.

6.9 Creep

As it does not affect the ultimate strength of the section, its effect need not be considered in the calculations.

7 MATERIALS

7.1 The materials for reinforced concrete arches shall conform to the requirements of IS 456.

7.2 Concrete

Concrete mix shall be controlled concrete conforming to IS 456. Since arches carry primarily compressive stresses, it is economical to use high strength concrete as in columns. The maximum quantity of cement in the concrete mix shall preferably not exceed 530 kg/m³ of concrete as richer mixes may give rise to excessive shrinkage.

7.3 Steel

The steel reinforcement shall be mild steel or medium tensile steel bars conforming to IS 432 (Part 1).

8 STRESSES

8.1 The basic permissible stresses in concrete and steel should be in accordance with requirements of IS 456.

8.2 Combination of Stresses

When section is subjected to combine bending and direct stresses, the conditions specified in IS 456 should be satisfied.

8.3 Increase in Stresses

For various combination of loads specified in 5, the basic permissible stresses may be increased as recommended in IS 456:2000 for arches in buildings and as recommended in relevant Indian Standards for bridge arches.

9 CONFIGURATION**9.1 Shape of the Axis**

The shape of the arch axis should, as far as possible, coincide with the funicular polygon for dead loads.

9.1.1 Fixed Arches

For preliminary design, the shape of arch axis as given by the following equation may be adopted (see Fig. 6), taking origin of the coordinates at the crown of the arch:

$$y = \frac{h}{m - 1} \left(\text{Cosh} \frac{2px}{L} - 1 \right)$$

where

y = vertical distance of any point on the arch axis from the crown,
 h = rise of the arch,

$$m = \frac{W_s}{W_c}$$

W_s = average load on the arch per unit length of span near springing,

W_c = average load on the arch per unit length of span near crown,

$$p = \log e \left(m + \sqrt{m^2 - 1} \right)$$

x = horizontal distance of any point on the arch axis from the crown, and

L = span of the arch measured from the centre line at the Springing.

NOTE — The value of m varies from 1.4 to 3 for open spandrel arches and from 3.5 to 8 for filled spandrel arches.

9.1.1.1 If the decking is provided below the crown level, the arch axis may be taken to be a parabola.

9.1.2 Bow String Girders

The dead loads on such arches being almost uniform, their axis should preferably be kept parabolic.

9.2 Rise of Arch

The rise of arches should generally be between one third to one sixth of the span for economy, the smaller value being applicable to relatively longer spans and the larger value for relatively smaller spans. Flatter arches have greater moments due to temperature, shrinkage etc, and those with bigger rise have greater length and higher cost of formwork.

9.3 Section of the Arch

In fixed arches, the section is increased from crown towards springing. The increase in depth at the springing should be 50 to 75 percent over that at the crown. The variation in the moment of inertia of the arch section is provided by the following relation (see Fig. 6):

$$I = \frac{I_c}{\left(1 - (1 - n) \frac{4x^2}{L^2}\right) \cos\theta}$$

where

I = moment of inertia of the arch rib at any section,

I_c = moment of inertia of the arch rib at any crown,

$$n = \frac{I_c}{(I_s \cos\theta_s)}$$

θ_s = angle which the tangent to the arch axis makes with the horizontal at the springing,

x = horizontal distance of the section from crown,

L = span of the arch,

θ = angle which the tangent to the arch axis makes with the horizontal at the section under consideration, and

I_s = moment of inertia of the arch rib at the springing.

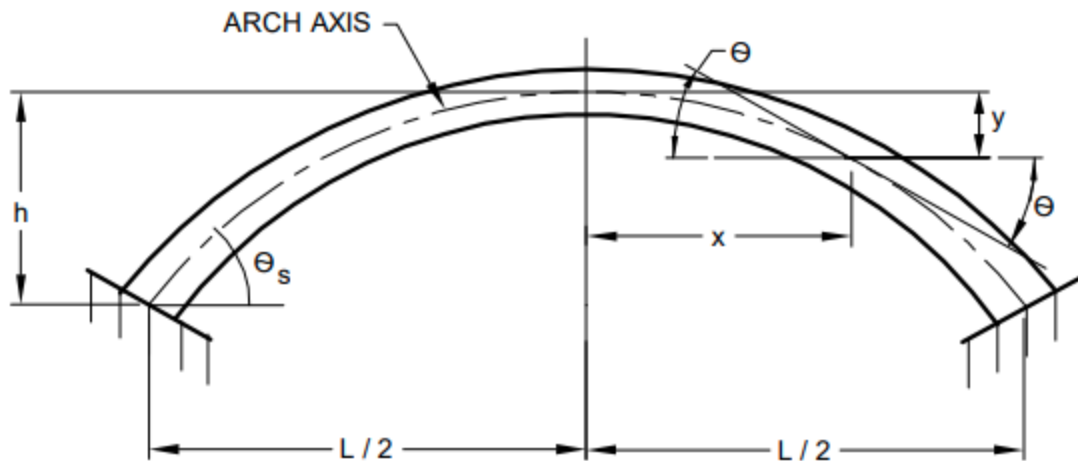


FIG.6 SHAPE OF AXIS OF FIXED ARCH

10 ANALYSIS

10.1 General

10.1.1 Arch Axis

In the analysis, the centroidal axis of the concrete section may be taken as the arch axis.

10.1.2 Moment of inertia

The moment of inertia of reinforced concrete section shall be calculated in accordance with requirements of IS 456.

10.1.3 Modulus of Elasticity of concrete

Unless otherwise determined by tests, the modulus of elasticity of concrete, E , should be in accordance with IS 456.

10.1.4 Modulus of Elasticity of Steel

Unless otherwise specified, the modulus of elasticity E , for mild steel and medium tensile steel shall be in accordance with IS 456.

10.2 Preliminary Analysis

10.2.1 Arch Axis

The arch axis for preliminary design may be assumed as in 9.1.1.

10.2.2 Dead Load Thrusts

Certain arbitrary dimensions of the arch section may be assumed for the computation of dead loads at the springing and the crown.

The dead load horizontal thrust H is given by the following expression:

$$H = \frac{m - 1}{4p^2} \frac{W_c L^2}{h}$$

where

$$m = \frac{W_s}{W_c}$$

W_s = average load on arch per unit length of span near springing,

W_c = average load on arch per unit length of span near crown,

$$p = \log e \left(m + \sqrt{m^2 - 1} \right)$$

L = span of the arch, and

h = rise of the arch.

10.2.3 Live Load Moments and Thrusts

The influence lines for moments at crown, quarter-point and springing point and for horizontal thrust and shear corresponding to equations in 9.1.1 and depth variation in 9.3, arc given in Fig. 7 to 12.

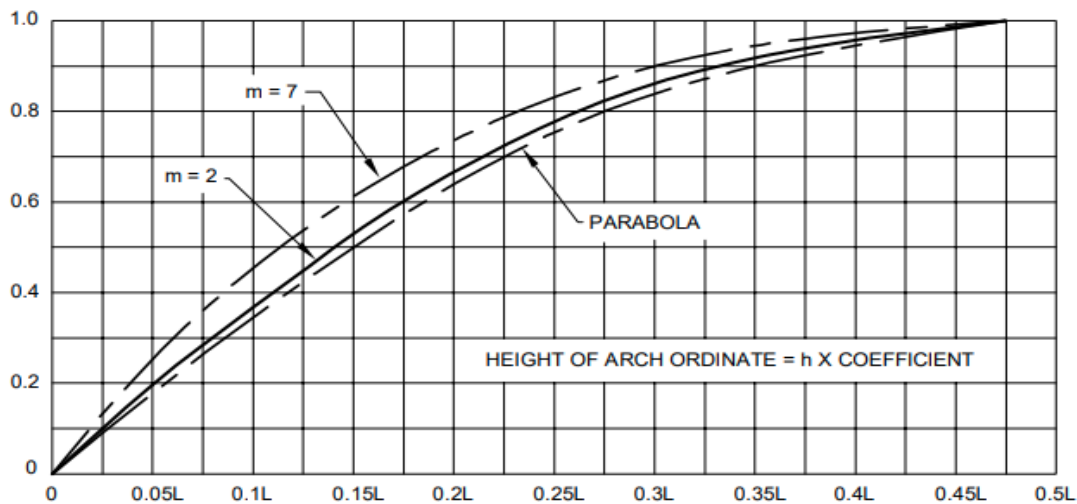


FIG. 7 ARCH AXIS

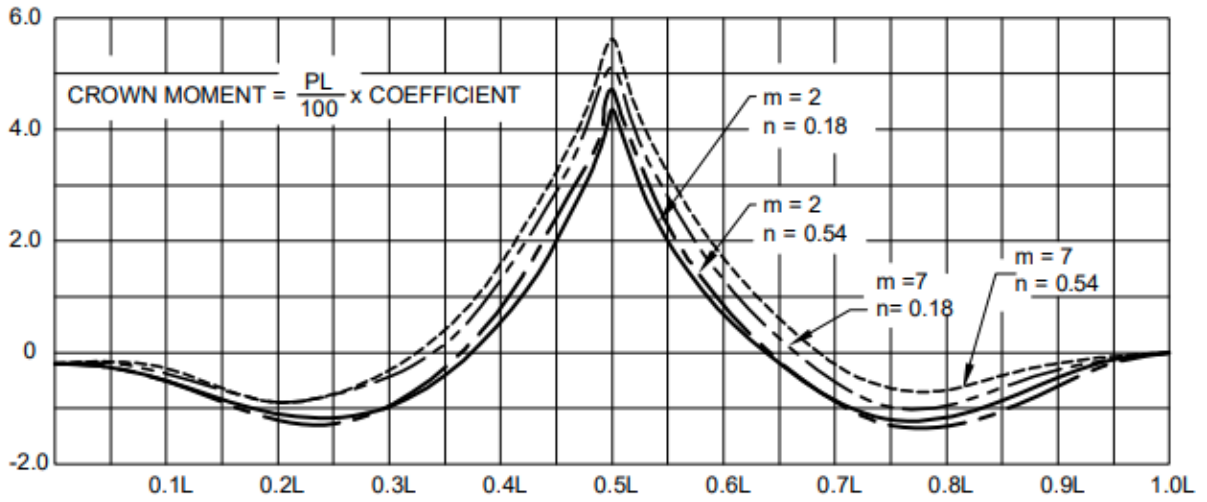


FIG. 8 INFLUENCE LINES FOR MOMENT AT CROWN

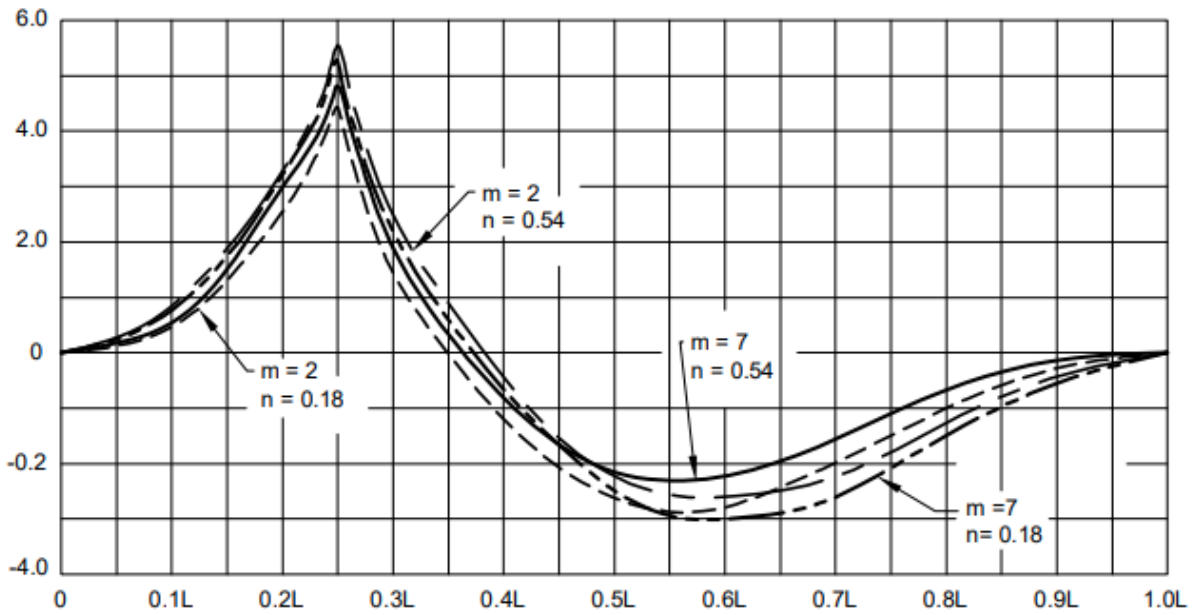


FIG. 9 INFLUENCE LINES FOR BENDING MOMENT AT QUARTER POINT

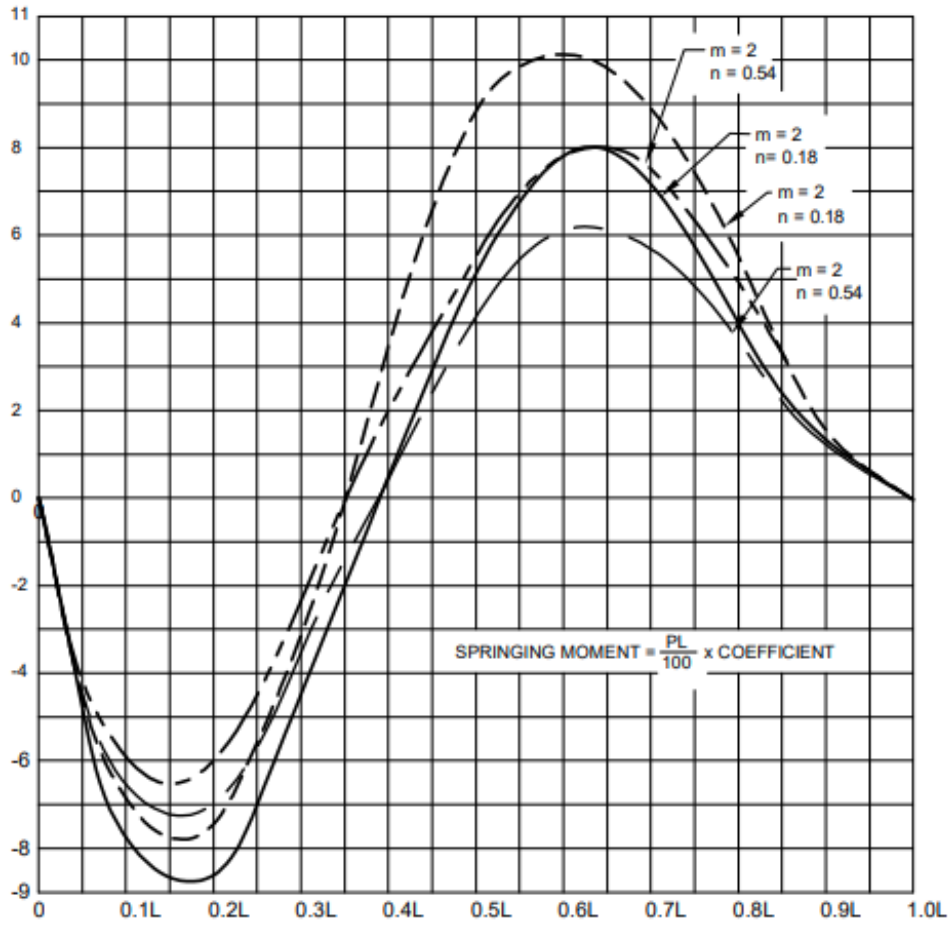


FIG. 10 INFLUENCE LINES FOR MOMENT AT SPRINGING

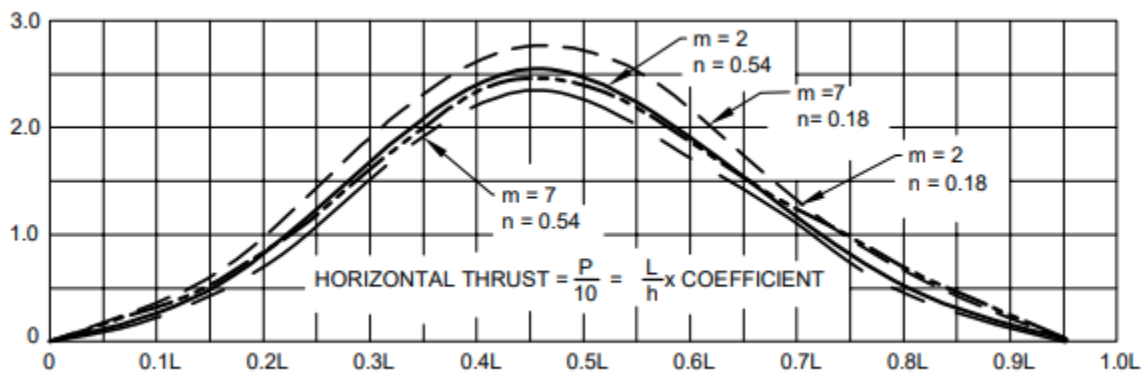


FIG. 11 INFLUENCE LINES FOR HORIZONTAL THRUST AT CROWN

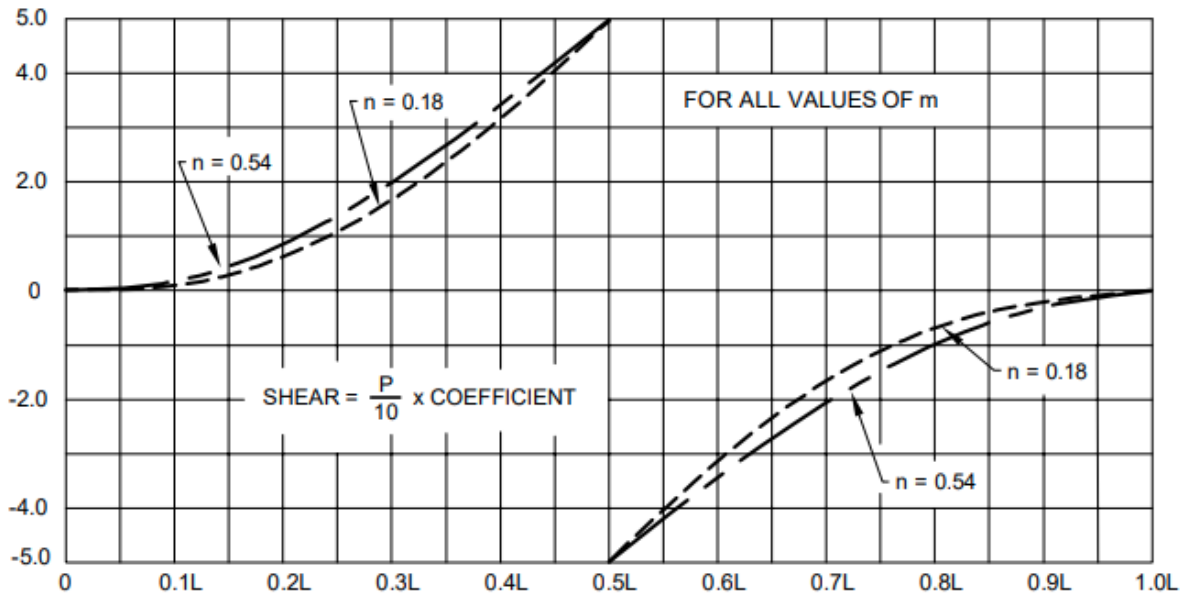


FIG. 12 INFLUENCE LINES FOR SHEAR AT CROWN

10.2.4 Temperature Stresses

The horizontal thrust and the moment at crown due to a change in temperature are given by the following expressions:

$$H_T = T\alpha E_c \frac{(m-1)^2}{h} I_c \frac{f_1}{f_3}$$

$$M_{CT} = T\alpha E_c \frac{(m-1)}{h} I_c \frac{f_1}{f_3}$$

where

- H_T = horizontal thrust due to temperature
- M_{CT} = moment at crown due to temperature,
- T = rise in temperature (see 10.2.4.1 and 10.2.4.2),
- α = coefficient of linear thermal expansion of concrete,
- E_c, m, n, I_c, h = as defined in 4, 9.1.1 and 9.3, and
- f_1, f_2, f_3 = coefficient given in Table 1.

Table 1 Coefficients
(Clause 10.2.4)

n	f_1	$m = 2$		$m = 7$	
0.18	0.726 7	0.157 6	0.029 4	0.779 8	0.886 4
0.54	0.846 7	0.226 8	0.052 7	1.532	1.671 0

10.2.4.1 The rise and fall in temperature shall be fixed for the locality in which the structure is to be constructed and shall be figured from an assumed temperature at time of erection. Due consideration shall be given to the lag between air temperature and the interior temperature of massive concrete members or structures.

10.2.4.2 Unless otherwise stated the following range of temperature may generally be assumed in the design:

	Temperature rise °C	Temperature fall °C
Moderate climate	17	17
Extreme climate	25	25

NOTE — Intermediate values may be allowed at the discretion of the engineer responsible for design.

10.2.5 Rib Shortening

The horizontal thrust (H_s) and the moment at the crown (M_{cs}) due to rib shortening for the assumed arch axis are given by the following equations:

$$H_s = -H \left(\frac{m-1}{h} \right)^2 \left(\frac{I_c^2}{12b^2} \right)^{\frac{1}{3}} \beta \frac{f_1}{f_3}$$

$$M_{cs} = H \left(\frac{m-1}{h} \right) \left(\frac{I_c}{12b^2} \right)^{\frac{1}{3}} \beta \frac{f_2}{f_3}$$

where

$$\beta = \left[1 + \frac{16}{9} \left(\frac{h}{L} \right)^2 - (I-n) \left\{ \frac{1}{9} + \frac{16}{15} \left(\frac{h}{L} \right)^2 \right\} \right]$$

H = horizontal thrust due to dead load,
 b = width of arch rib or unit width of arch slab, and
 f_1, f_2, f_3 = coefficients given in Table 1.

10.3 Exact Analysis

After the preliminary analysis and design of the arch has been completed, the arch axis can be modified to follow the line of thrust of dead loads. The moments and thrusts at crown, quarter point and springing may be computed by any suitable procedure of arch analysis.

10.3.1 In an open spandrel arch, the arch may be designed without taking account of the monolithic connection with the supported structure.

10.3.2 Expansion joints in the deck should preferably be placed at end of the span so that the deck may act as a horizontal girder to bear transverse forces.

10.3.3 A bow-string girder may be analysed as a virendeel girder or as a two hinged arch. The effect due to elastic extension of the tie should be accounted for in the design.

10.4 Settlement of Supports

The arches are normally built on the firm ground where there is practically no relative settlement of supports. If the settlements can be pre-calculated taking soil conditions into account, these may be taken into consideration in calculating moments and thrusts.

11 WORKING LOAD DESIGN

11.1 Critical Sections

For purposes of design, it is usual to check three sections of the arch, that is, crown, quarter point and springing.

11.2 Dead Load

Any possible variation in the magnitude or distribution of dead load or in the axis of the arch is allowed for by checking the arch for a moving point load equal to ± 2.5 percent of the total dead load thrust at crown so as to produce worst effect at the section.

11.3 Minimum Width of Arch Rib

Minimum width of the arch rib should not be less than $1/30$ th of its axial length. For more slender ribs, lateral bracing should be provided.

11.4 Deflection moments

Deflection Moments should be taken into account while designing arches having span greater than 120 m.

11.4.1 To obtain deflection moments, the analysis is first made for separate loads. Then the moments and thrusts due to various causes are same combined as to obtain maximum moment at a section. Under the same condition of loading deflection moments are calculated for that section. In these calculations, the properties of the undeflected arch axis may be used without much error.

11.5 The arch sections shall be checked for the following combination of loads:

- a) $DL + LL$
 b) $DL + LL + WL$ } with normal permissible stresses

Where,

- DL = dead load on the arch,
 LL = any other load for which an increase in permissible stresses is not allowed, and
 WL = loads with which an increase in permissible stresses is allowed.

11.5.1 Where stresses due to wind (or earthquake), temperature and shrinkage effects are combined with those due to dead, live and impact loads, the permissible increase in stresses shall be in accordance with the recommendations of IS 456. No relaxation shall be made, when stresses due to shrinkage are considered.

12 ULTIMATE LOAD DESIGN

12.1 Elastic method of analysis is used to compute the maximum bending moment and thrust, and the strength of the section may be computed on the basis of ultimate load formulae.

12.1.1 The arch section should be designed with the following ultimate strengths to provide an adequate factor of safety against over loads and freedom from excessive cracking:

$$U = DL + 3LL$$

$$U = 2(DL + LL)$$

Where,

- U = ultimate strength capacity,
 DL = dead loads of the arch, and
 LL = live loads including impact

The strength of the arch section should be checked with the live load placed to give maximum moment as well as maximum thrust.

12.2 Ultimate Strength of Section

The ultimate strength of sections under direct and bending stresses shall be calculated as per requirements of IS 456.

13 REINFORCEMENT (from AASHTO)

Arch ribs in reinforced concrete construction shall be reinforced with a complete double line of longitudinal reinforcement consisting of an intradosal system and an extradosal system connected by a series of stirrups or tie-rods. For barrel arches, a system of transverse reinforcement, thoroughly anchored to the longitudinal reinforcement, shall be used in both intrados and extrados. The transverse reinforcement shall be proportioned to resist the bending stresses due to any overturning action of the spandrel wall. For rib arches, hoops or tie bars shall be used in connection with the longitudinal rib reinforcement, as in the case of reinforced concrete columns.

13.1 Longitudinal Reinforcement

The cross-sectional area of longitudinal reinforcement should be not less than 0.8 percent of the area of the arch section.

The practice of placing bars only on the tension face and bending to the other face where the bending moment changes sign is not recommended.

13.2 Lateral Ties

Lateral ties conforming to the requirements of IS 456 should be provided to tie the longitudinal bars in the arch ribs.

13.3 Transverse Reinforcement

In arch slabs, transverse reinforcement shall be provided for distribution, temperature and shrinkage. The minimum transverse reinforcement on each face of the slab shall be 0.2 percent of the sectional area.

13.4 Shear Reinforcement

In bow-string girder, special shear reinforcement shall be provided at the junctions of arch and tie.

13.5 Splicing and Anchorage

The main reinforcement bars may be anchored into the abutments or spliced to develop their full strength by bond.

13.5.1 In the case of ties and suspenders of the bow-string girders, no reliance can be placed on bond alone to transmit tension at laps or member to the arch. The bars should be spliced by welding or other suitable mechanical means and joints in bars should be staggered. The ends of the bars may be provided with nuts and washers to bear against concrete.

14 SUPPORTS

14.1 The supports are built in masonry or plain and reinforced concrete unless the arch is supported on a rock directly.

14.2 All the piers and abutments shall be checked jointly as well as individually for block stability, stresses under the reactions from the arch and other forces directly coming on them.

14.2.1 In fixed arches, the reactions from the arch should be calculated under two conditions of loading, one giving maximum horizontal thrust and the other giving maximum moment at springing.

14.2.2 For intermediate piers, the stability should be checked with the combined effect of both spans giving a) maximum side thrust and b) maximum overturning moment.

14.3 Bearings in Bow String Girder

Any suitable bearing which allows the full expansion of the tie may be used. One end of the bow string girder may be put on rocker bearing and the other roller bearing. For efficient working, the roller bearing may be of steel.

15 HINGES

15.1 In concrete arches, hinges are usually not provided on a permanent basis. Temporary hinges may be provided during construction to eliminate the moments due to rib shortening, shrinkage, settlement of abutments etc. These are provided at the springings and at the crown.

15.2 Temporary Hinge

It is made as flexible as possible by providing a small section and a high percentage of compression steel together with spiral reinforcement. The compressive stress in concrete is kept about 80 percent of its ultimate strength. The hinge section is designed as a column having about 8 percent longitudinal reinforcement and maximum amount of spiral reinforcement as given in IS 456. The length of the hinge should not be greater than twice the smaller dimension of its section. Suitable steel meshes should be provided to distribute the load from the hinge to the main member.

The main reinforcement of the arch should continue on either side of the hinge. When the hinge has to be eliminated, the arch rib is filled with concrete round the hinge and the full section becomes effective to resist moments (see Fig. 13).

16 CONSTRUCTION JOINTS

16.1 The number of joints should be kept minimum. The joints in the arch should be radial and a shear key should be provided at the joints. The longitudinal reinforcement should be continuous at the joints. To obtain good joints, the precautions in laying new concrete against the old surface should be followed as recommended in IS 456.

16.2 Filled Spandrel Arches

If the face walls on either side are built in concrete, these should be properly anchored into the arch slab and a shear key should be provided at the junction. Vertical expansion joints should be provided in face walls so that they do not put up any resistance to the arch slab when it deforms under load; this will also avoid unsightly cracks in the walls.

From AASHTO (*added in present revision*):

Expansion Joints

Vertical expansion joints shall be placed in the spandrel walls of arches to provide for movement due to temperature change and arch deflection. These joints shall be placed at the ends of spans and at intermediate points, generally not more than 50 feet apart.

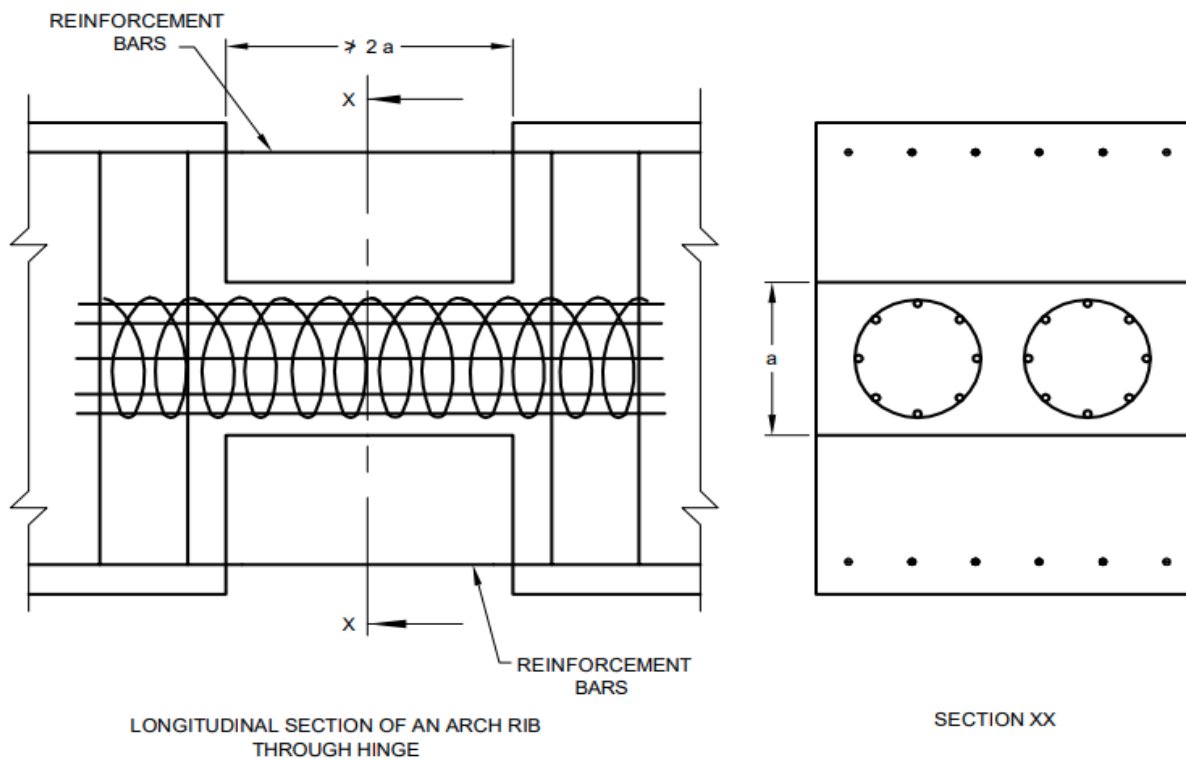


FIG. 13 TYPICAL TEMPORARY HINGE (CONCRETE NOT SHOWN)

16.3 Open Spandrel Arches

The spandrel supports should have construction joints over the arches and under the deck beams. Their reinforcement should be fully anchored into the arch ribs and the deck beams.

16.3.1 Joints in the columns braces can be given at face of columns with a recess about 12 mm.

16.3.2 Construction joints in the deck beams should be given at the center of columns and those in the deck slab over cross beams. The reinforcement at the joint should be continuous in both cases.

16.4 Bow String Girders

In these, the decking and arch ribs should be concreted first leaving the reinforcement of suspenders and ties open. After the concrete has hardened, the centering of arch and decking should be removed so that the tie and suspenders take their full dead load stresses. These should then be concreted in the stressed condition.

Waterproofing (from AASHTO)

Preferably, the top of the arch and the interior faces of the spandrel walls of all filled spandrel arches shall be waterproofed with a membrane waterproofing or any other suitable waterproofing method.

17 STRIKING THE CENTRING

17.1 To avoid unsymmetry of dead loads on the arch which will cause heavy moments, the centering should be removed gradually in stages symmetrically from the crown. For this purpose, it will be better if the centring is erected on screw jacks, wedges or sand boxes which can be lowered symmetrically. Centering should not be struck till the concrete has attained a strength of at least double the stresses developed on decentering.

17.2 Filling in the spandrel portion shall be done after decentering and when the concrete has attained full strength.

References:

Standard Specifications for Highway Bridges, adopted by The American Association of State Highway Officials, Eleventh Edition, 1973, Published by the Association General Offices, 341 National Press Building Washington, D.C20004